


| | | | |
|-------------|--|------------------|--------------------------------|
| Start | 07:54:41 August 5, 2022 | Serial Number | UM13981 Micromate ISEE 10.90GC |
| Finish | 09:15:43 August 5, 2022 | Battery Level | 3.8 Volts |
| Intervals | 82 At 60 sec | Unit Calibration | 2022-01-21 by Instantel |
| Range | Geo: 10.0 in/s | File Name | UM13981_20220805075441.IDFH |
| Sample Rate | 1024 Sps | Post Event Notes | — |
| Notes | — | | |
| Project: | UPMC Presby-Loc 3-Level1-1R Elevator Rm | | |
| Client: | Whiting-Turner - PJ Dick - Joint Venture | | |
| User Name: | Terra-Mechanics, Inc. - D. Harrsion | | |
| Seis. Loc: | — | | |

Microphone Linear Weighting
 PSPL 116.4 dB(L)
 ZC Freq 39 Hz
 Channel Test Passed (Freq = 20.5 Hz, Amp = 1314 mv)

| | Tran | Vert | Long | |
|--------------|-----------|-----------|-----------|------|
| PPV | 0.157 | 0.131 | 0.077 | in/s |
| ZC Freq | 51 | 30 | 11 | Hz |
| Date | Aug 5 /22 | Aug 5 /22 | Aug 5 /22 | |
| Time | 09:15:43 | 09:15:43 | 08:09:41 | |
| Sensor Check | Passed | Passed | Passed | |

Peak Vector Sum 0.204 in/s on August 5, 2022 At 09:16:41
 NA: Not Applicable

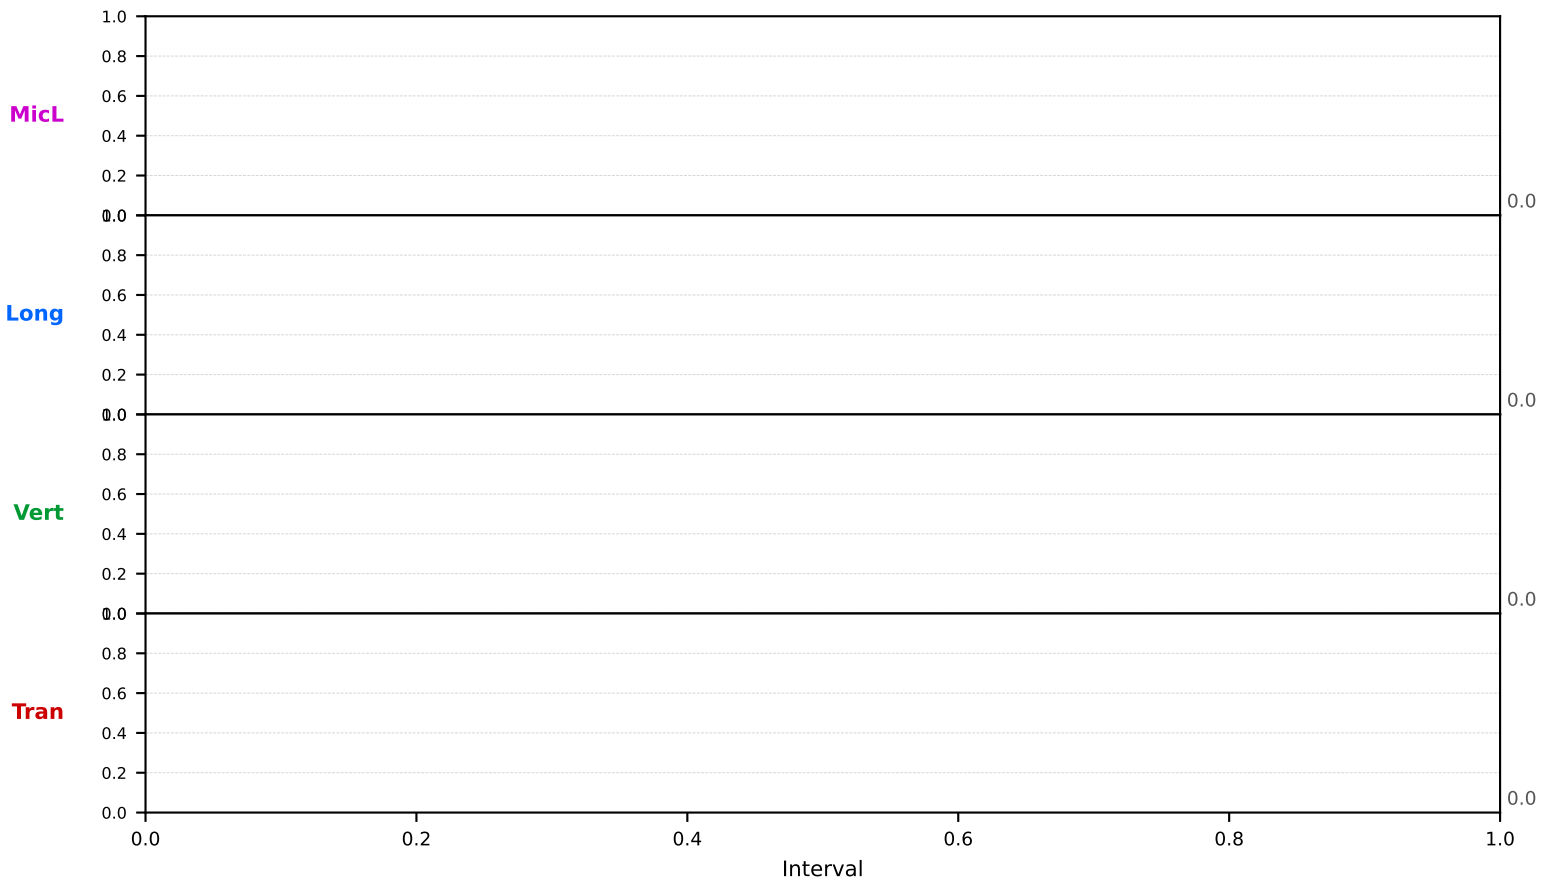

Time 60 sec /div Amplitude Geo: 0.005 in/s/div Mic: 0.001 psi(L)/div